

The BRE logo is displayed in a bold, lowercase, yellow sans-serif font. It is positioned on the left side of the page, set against a dark teal background that features a complex pattern of thin, overlapping yellow lines that create a sense of depth and movement, resembling a stylized architectural or acoustic structure.

bre

**Rytons Building  
Products Ltd.  
Laboratory Sound  
Insulation Test of Core  
Ventilators in the BRE  
Horizontal Transmission  
Suite**


Prepared for:  
Design House  
Orion Way  
Kettering Business Park  
Kettering Northants  
NN15 6NL

3<sup>rd</sup> April 2013

Test report number **284908**



0578

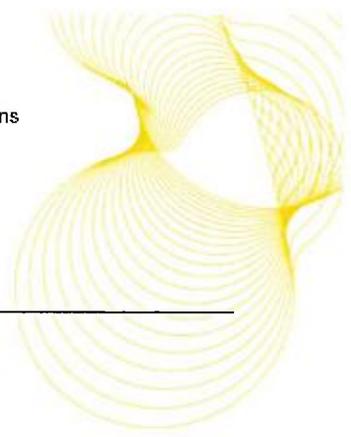

**Tested by**

---

Name Mr I West  
Position Acoustics Laboratory Manager  
Date 13<sup>th</sup> February 2013  
Signature

**Prepared by**

---

Name Mr I West  
Position Acoustics Laboratory Manager  
Date 15<sup>th</sup> February 2013  
Signature

**Checked by**

---

Name Roger Sadgrove  
Position Principal Consultant  
Date 21<sup>st</sup> February 2013  
Signature

**Approved on behalf of BRE**

---


Name Dr P Blackmore  
Position Associate Director  
Date 21<sup>st</sup> February 2013  
Signature

BRE  
Garston  
WD25 9XX  
T + 44 (0) 1923 664000  
F + 44 (0) 1923 664010  
E [enquiries@bre.co.uk](mailto:enquiries@bre.co.uk)  
[www.bre.co.uk](http://www.bre.co.uk)

BRE is not UKAS accredited to make opinions and interpretation. Any opinions and interpretations included as part of this report are clearly marked as such.




This report may only be distributed in its entirety and in accordance with the terms and conditions of the contract. Test results relate only to the items tested. BRE has no responsibility for the design, materials, workmanship or performance of the product tested. 0578  
This report does not constitute an approval, certification or endorsement of the product tested and can not be reproduced without permission. This report is made on behalf of BRE. By receiving the report and action on it, the client – or any third party relying on it – accepts that no individual is personally liable in contract, tort or breach of statutory duty (including negligence).

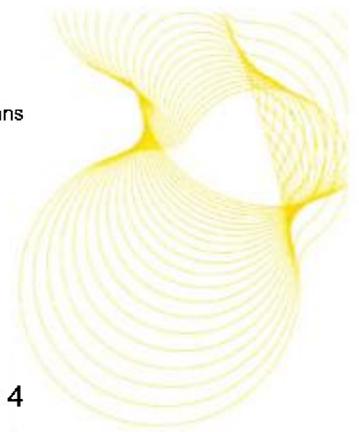

## Contents

1	Introduction	4
2	Testing details	4
2.1	Test dates and personnel	4
2.2	Test method and applicable standards	4
2.3	Test element installation	4
2.4	Instrumentation	5
2.5	Test numbers	6
2.6	Construction details, test numbers and sound insulation test results	7
2.7	Plans	8
3	Appendices	9
3.1	UKAS test result sheets	9
3.2	Octave and third-octave band data	9

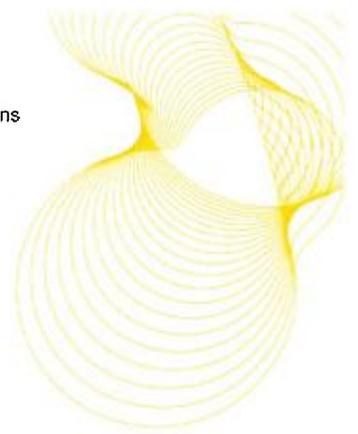

## 1 Introduction

BRE Acoustics was commissioned by Rytons Building Products Ltd to carry out airborne sound insulation measurements in the BRE horizontal transmission suite (Building 9), BRE, Garston, Watford, Hertfordshire, WD25 9XX.

This report details the testing outlined in BRE proposal 132491.

## 2 Testing details

### 2.1 Test dates and personnel

The measurements detailed in this report were made on 13<sup>th</sup> February 2013 by Mr I West of BRE Acoustics.


### 2.2 Test method and applicable standards

Measurement of airborne sound insulation was made in accordance with BS EN 20140-10: 1992. Single number quantities were calculated in accordance with BS EN ISO 717-1:1997.

BRE Acoustics holds UKAS accreditation for the measurement of sound insulation in the field and the laboratory. The measurements were conducted using the procedures accredited by UKAS.

### 2.3 Test element installation

The filler wall was installed by BRE; the ventilators were installed by Rytons Building Products Ltd.

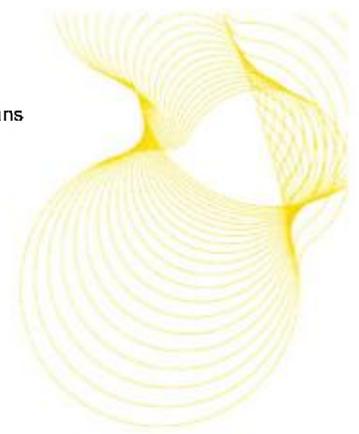

## 2.4 Instrumentation


The equipment used to conduct the tests is identified in Table 1.

**Table 1** Equipment list

Equipment description	Manufacturer	Type	UKAS identification number
Microphone Calibrator	NOR	1253	01/009
Microphone	B&K	4188-A-O	02/203, 02/204
Microphone Preamplifier	B&K	2671	04/203, 04/204
Microphone Adapter	NOR	NE1449	06/101, 06/102
Graphic Equaliser	Phonic	PEQ3300	10/002
Amplifier	NOR	260H	11/013
Real Time Analyser	NOR	840	13/002
Microphone Rotating Boom	NOR	212NA	14/004, 14/005
Loudspeaker	B&K	4224	11/006
Dodecahedron speaker	Norsonic	270H	11/014, 11/016

The gain of the real time analyser was adjusted to give a reading of 124.0 dB at 250 Hz using the NOR type 1253 calibrator.

All equipment is calibrated in accordance with BRE procedures, using reference equipment calibrated by a UKAS accredited laboratory.

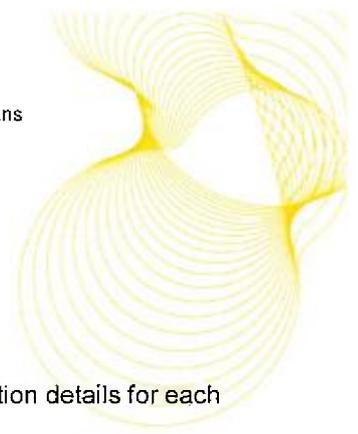


## 2.5 Test numbers

Table 2 lists each test element along with its corresponding test number. The construction details for each test element can be found from Table 3 by referring to the test number.

**Table 2** Test numbers

Test number	Test element	Source room volume (m <sup>3</sup> )	Receive room volume (m <sup>3</sup> )	Common area (m <sup>2</sup> )
L112-110	Filler Wall	130	115	9.8
L112-072	Ventilator	130	115	9.8
L112-076	Ventilator	130	115	9.8
L112-077	Ventilator	130	115	9.8
L112-078	Ventilator	130	115	9.8
L112-079	Ventilator	130	115	9.8
L112-080	Ventilator	130	115	9.8
L112-081	Ventilator	130	115	9.8
L112-082	Ventilator	130	115	9.8
L112-083	Ventilator	130	115	9.8
L112-084	Ventilator	130	115	9.8

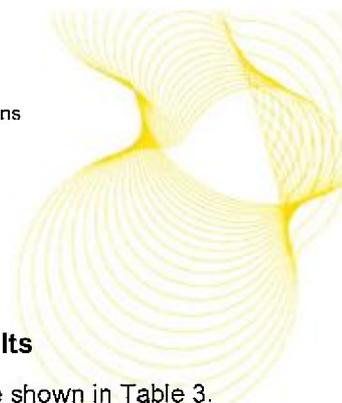


## 2.6 Construction details, test numbers and sound insulation test results

The construction details and single number quantities for the sound insulation tests are shown in Table 3. When construction details are provided by a third party, they are checked by BRE where possible. The UKAS test result sheets are included in the appendices with the octave and third octave band results.

**Table 3** Construction details


Test element	Test number	Construction details	$D_{n,e,w}(C;C_{tr})$ (dB)
Filler wall	L112-110	2x13mm gypsum based board (9.0kg/m <sup>2</sup> ) perimeter taped screwed to 70mm metal stud (0.5kg/m <sup>2</sup> ) at 600mm centres with 100mm insulation (10kg/m <sup>3</sup> ), 100mm air gap, 100mm insulation (10kg/m <sup>3</sup> ), 70mm metal stud (0.5kg/m <sup>2</sup> ) at 600mm centres screwed to 2x13mm gypsum based board (9.0kg/m <sup>2</sup> ) perimeter taped	64(-3;-9)*
Ventilator	L112-072	AAC125TUBE- Super Acoustic AirCore® Tube (358mm L)	44(0;-2)
	L112-076	AAC125LP- Super Acoustic LookRyt® AirCore®	44(0;-2)
	L112-077	AAC125LPCWL – Cowled Super Acoustic LookRyt® AirCore®	45(0;-3)
	L112-078	AAH125LP-High Rise Super Acoustic LookRyt® AirCore®	44(0;-2)
	L112-079	AAC125HP-OPEN- Super Acoustic Controllable LookRyt® AirCore®	43(0;-2)
	L112-080	AAC125HP-CLOSED- Super Acoustic Controllable LookRyt® AirCore®	50(-1;-3)
	L112-081	AAC125HPCWL – OPEN – Cowled Super Acoustic Controllable LookRyt® AirCore®	45(-1;-3)
	L112-082	AAC125HPCWL-CLOSED- Cowled Super Acoustic Controllable LookRyt® AirCore®	50(-1;-4)
	L112-083	AAH125HP-OPEN- High Rise Super Acoustic Controllable LookRyt® AirCore®	44(0;-2)
	L112-084	AAH125HP-CLOSED- High Rise Super Acoustic Controllable LookRyt® AirCore®	50(0;-3)

\*This is equivalent to  $D_{n,e,F,w}$ .  $D_{n,e,F,w}$  is defined in BS EN 20140-10: 1992.

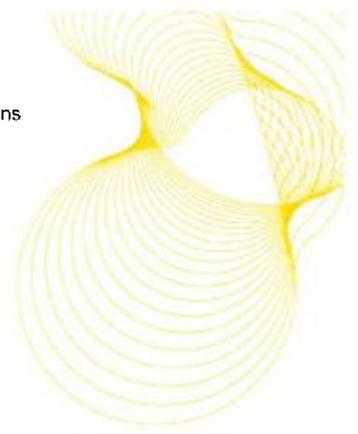


## 2.7 Plans

The position of the filler wall in the transmission suite aperture is indicated in Figure 1

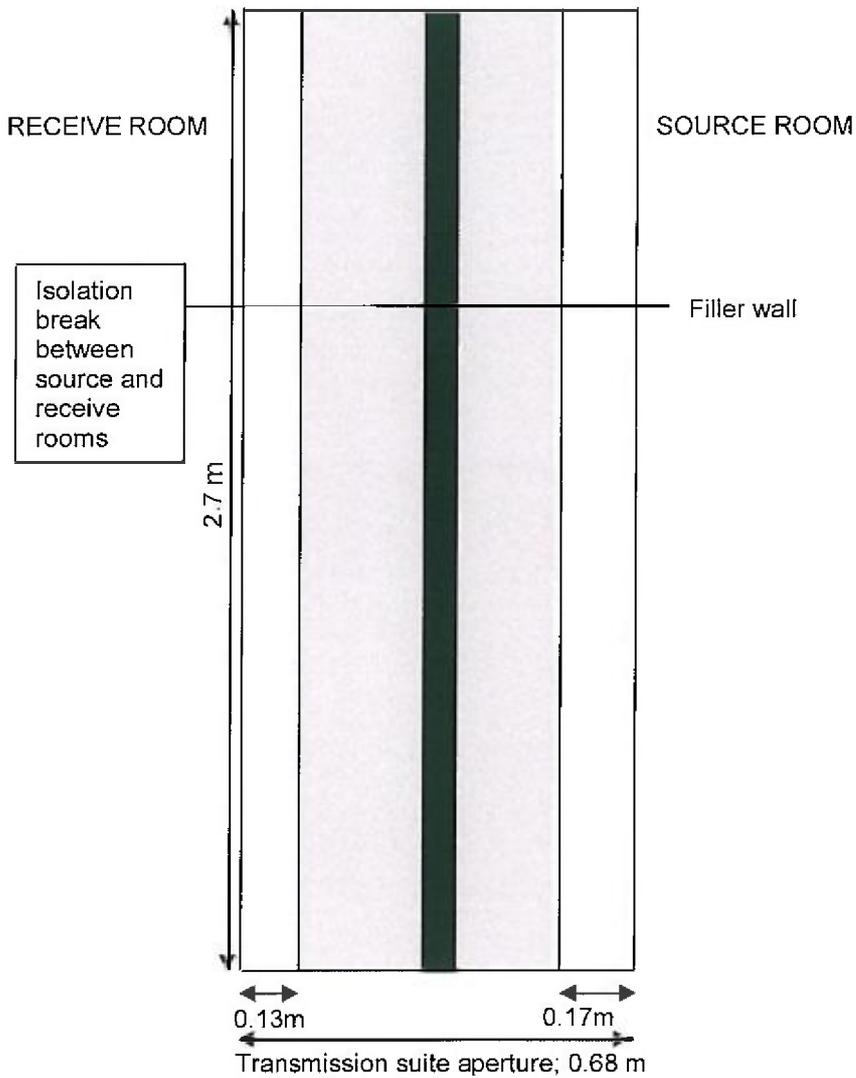

**Figure 1** Section through elevation showing the position of the filler wall in the transmission suite aperture

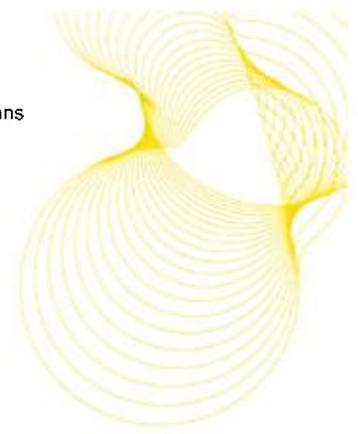

### **3 Appendices**

#### **3.1 UKAS test result sheets**

Page number	Test number
10	L112-110
12	L112-072
14	L112-076
16	L112-077
18	L112-078
20	L112-079
22	L112-080
24	L112-081
26	L112-082
28	L112-083
30	L112-084

#### **3.2 Octave and third-octave band data**

31





**Laboratory measurement of airborne sound insulation of building elements**  
**Sound reduction index according to BS EN ISO 140-3:1995**  
**B9, Horizontal Transmission Suite**

**Client:** Rytons Building Products Ltd

**Test date:** 12/02/2013

**Test number:** L112-110

**Test element:** Filler Wall

0578

**Test element area:** 9.8 m<sup>2</sup>

**Description:**

See Table 3

**Source room volume:** 130 m<sup>3</sup>

**Receive room volume:** 115 m<sup>3</sup>


**Air temperature:** 9 °C

**Air relative humidity:** 54 %

Frequency (Hz)	R One-third octave (dB)
50	23.4
63	23.7
80	29.6
100	37.5
125	41.8
160	46.6
200	50.6
250	54.0
315	58.4
400	62.2
500	63.8
630	67.2
800	68.7
1,000	73.0
1,250	76.7
1,600	79.4
2,000	79.9
2,500	76.0
3,150	78.0
4,000	83.9
5,000	86.6

+ Receiving room level adjusted for background

\* Receiving room level within 5 dB of background

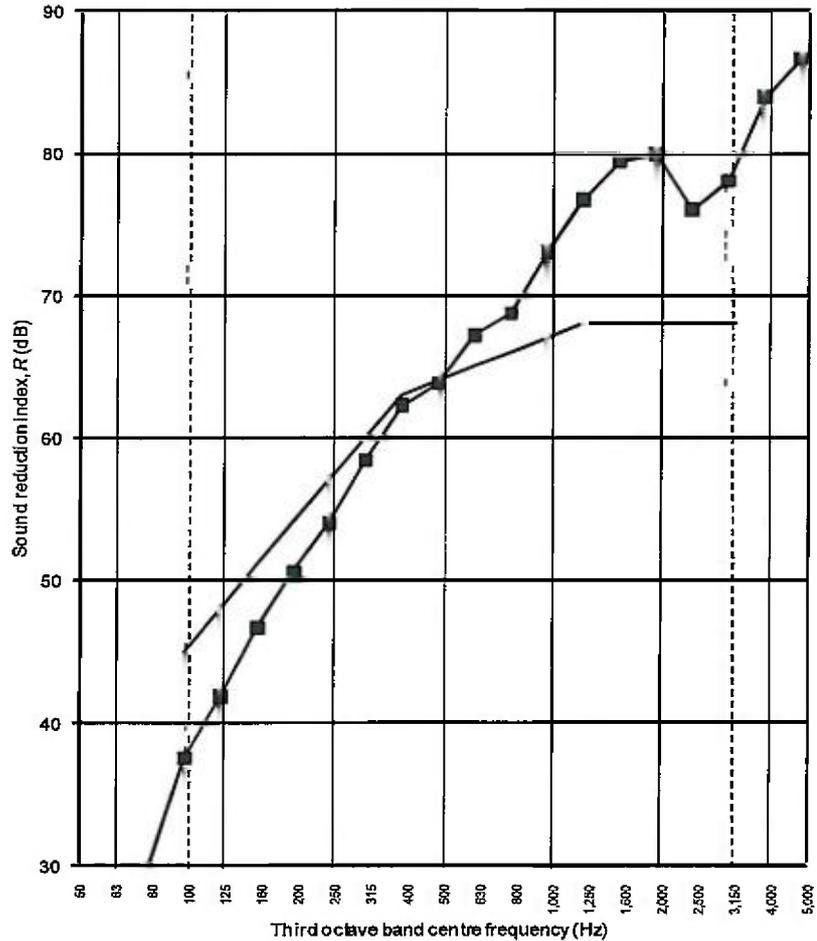


Rating according to BS EN ISO 717-1:1997

$R_w (C; C_{tr}) = 64 (-3; -9) \text{ dB}$	$C_{50-3150} = -8 \text{ dB}$	$C_{50-5000} = -7 \text{ dB}$	$C_{100-5000} = -2 \text{ dB}$
	$C_{tr, 50-3150} = -21 \text{ dB}$	$C_{tr, 50-5000} = -21 \text{ dB}$	$C_{tr, 100-5000} = -9 \text{ dB}$

Evaluation based on laboratory measurement results obtained by an engineering method

Based on the data provided in BS EN 20140-2:1993 it is estimated that the measurement uncertainty should not exceed  $\pm 1 \text{ dB}$  for the single quantity ( $R_w$ ) and should not exceed the values in Table A1 of BS EN 20140-2:1993 for the data in the individual third octaves (R)

This page may only be distributed with the test report in its entirety and in accordance with the terms and conditions of the contract

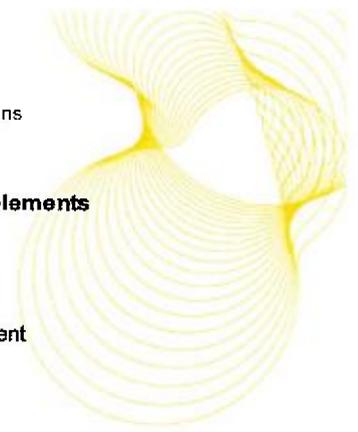

**Laboratory measurement of airborne sound insulation of small building elements**  
**Element-normalized level difference according to BS EN 20140-10:1992**  
**BRE horizontal transmission suite (B9)**  
**Client:** Rytons Building Products Ltd  
**Test date:** 12/02/2013      **Test number:** L112-076      **Test element:** vent

0578

**Filler wall area:** 9.8 m<sup>2</sup>

**Description:**

AAC125LP- Super Acoustic LookRyt® AirCore®

**Source room volume:** 130 m<sup>3</sup>

**Air temperature:** 9 °C

**Receive room volume:** 115 m<sup>3</sup>

**Air relative humidity:** 55 %

Frequency (Hz)	Reverberation time (s)	Background level (dB)	Source level (dB)	Receive level (dB)	$D_{n,e}$ (dB)
50	1.68	23.1	92.9	69.6	24.2
63	1.51	20.1	98.0	73.0	25.5
80	1.28	17.7	96.4	64.3	31.8
100	1.56	19.4	97.8	58.2	40.2
125	1.72	16.6	98.6	56.6	43.0
160	1.72	16.8	96.9	52.5	45.4
200	1.80	12.1	98.2	56.9	41.7
250	1.58	14.6	96.1	59.6	35.9
315	1.66	11.0	93.9	56.5	36.9
400	1.60	11.8	92.6	53.6	38.3
500	1.57	15.7	93.7	55.9	37.1
630	1.61	14.7	95.2	55.5	39.1
800	1.59	12.1	95.5	55.1	39.8
1,000	1.56	9.3	95.1	49.5	44.9
1,250	1.62	11.3	95.5	41.0	53.9
1,600	1.59	12.8	95.8	38.9	56.3
2,000	1.57	10.3	93.4	39.2	53.5
2,500	1.51	8.7	93.7	35.4	57.4
3,150	1.38	7.5	94.7	30.8	62.6
4,000	1.25	7.9	99.8	27.5	70.7
5,000	1.13	7.4	100.1	26.9	71.0

x Adjusted for flanking transmission

o Correction = 13 dB

Rating according to BS EN ISO 717-1:1997					
$D_{n,e,w}(C;C_{tr}) = 44 (0;-2) \text{ dB}$	$C_{50-3150} = -1 \text{ dB}$	$C_{50-5000} = 0 \text{ dB}$	$C_{100-5000} = 1 \text{ dB}$		
	$C_{tr,50-3150} = -$	$C_{tr,50-5000} = -$	$C_{tr,100-5000} = -2 \text{ dB}$		
Evaluation based on laboratory measurement results obtained by an engineering method					
Based on the data provided in BS EN 20140-2:1993 it is estimated that the measurement uncertainty should not exceed $\pm 1 \text{ dB}$ for the single quantity ( $D_{n,e,w}$ ) and should not exceed the values in Table A1 of BS EN 20140-2:1993 for the data in the individual third octaves ( $D_{n,e,w}$ )					

This page may only be distributed with the test report in its entirety and in accordance with the terms and conditions of the contract



**Laboratory measurement of airborne sound insulation of small building elements**  
**Element-normalized level difference according to BS EN 20140-10:1992**  
**BRE horizontal transmission suite (B9)**  
**Client:** Rytons Building Products Ltd  
**Test date:** 12/02/2013      **Test number:** L112-076      **Test element:** vent

0578

**Filler wall area:** 9.8 m<sup>2</sup>


**Description:**

AAC125LP- Super Acoustic LookRyt® AirCore®

**Source room volume:** 130 m<sup>3</sup>  
**Receive room volume:** 115 m<sup>3</sup>

**Air temperature:** 9 °C  
**Air relative humidity:** 55 %

Frequency (Hz)	$D_{n,e}$ One-third octave (dB)
50	24.2
63	25.5
80	31.8
100	40.2
125	43.0
160	45.4
200	41.7
250	35.9
315	36.9
400	38.3
500	37.1
630	39.1
800	39.8
1,000	44.9
1,250	53.9
1,600	56.3
2,000	53.5
2,500	57.4
3,150	62.6
4,000	70.7
5,000	71.0

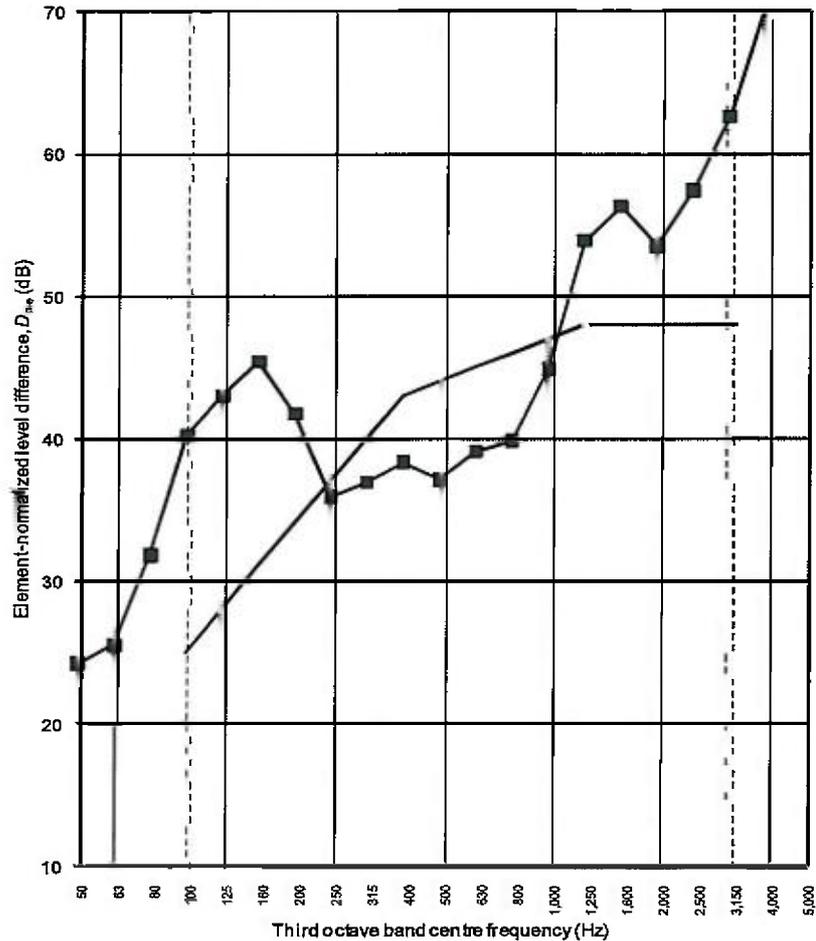

x Adjusted for flanking transmission

o Correction = 1.3 dB

Rating according to BS EN ISO 717-1:1997

$D_{n,e,w}(C;C_{tr}) = 44 (0;-2) \text{ dB}$	$C_{50-3150} = -1 \text{ dB}$	$C_{50-5000} = 0 \text{ dB}$	$C_{100-5000} = 1 \text{ dB}$
	$C_{tr,50-3150} = -$	$C_{tr,50-5000} = -$	$C_{tr,100-5000} = -2 \text{ dB}$

Evaluation based on laboratory measurement results obtained by an engineering method

Based on the data provided in BS EN 20140-2:1993 it is estimated that the measurement uncertainty should not exceed  $\pm 1 \text{ dB}$  for the single quantity ( $D_{n,e,w}$ ) and should not exceed the values in Table A1 of BS EN 20140-2:1993 for the data in the individual third octaves ( $D_{n,e,w}$ )

This page may only be distributed with the test report in its entirety and in accordance with the terms and conditions of the contract



**Laboratory measurement of airborne sound insulation of small building elements**  
**Element-normalized level difference according to BS EN 20140-10:1992**  
**BRE horizontal transmission suite (B9)**


**Client:** Rytons Building Products Ltd  
**Test date:** 12/02/2013      **Test number:** L112-077      **Test element:** vent

0578

**Filler wall area:** 9.8 m<sup>2</sup>

**Description:**

AAC125LPCWL – Cowled Super Acoustic LookRyt® AirCore®

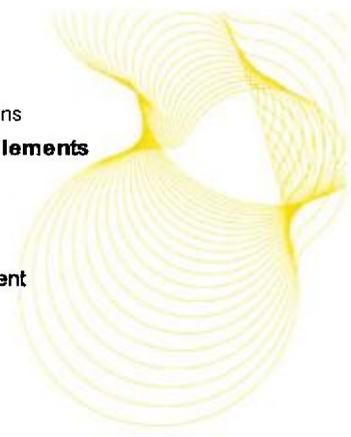

**Source room volume:** 130 m<sup>3</sup>  
**Receive room volume:** 115 m<sup>3</sup>

**Air temperature:** 9 °C  
**Air relative humidity:** 55 %

Frequency (Hz)	Reverberation time (s)	Background level (dB)	Source level (dB)	Receive level (dB)	<i>D</i> <sub>n,e</sub> (dB)
50	1.68	23.1	93.3	69.8	24.3
63	1.51	20.1	97.9	73.6	24.7
80	1.28	17.7	97.1	64.6	32.2
100	1.56	19.4	98.0	59.0	39.6
125	1.72	16.6	98.8	56.5	43.3
160	1.72	16.8	96.7	53.7	44.0
200	1.80	12.1	98.4	59.6	38.7
250	1.58	14.6	96.1	61.7	33.7
315	1.66	11.0	94.0	57.0	36.5
400	1.60	11.8	92.6	56.8	35.1
500	1.57	15.7	93.6	54.0	38.9
630	1.61	14.7	95.2	51.5	43.1
800	1.59	12.1	95.5	49.3	45.6
1,000	1.56	9.3	95.0	44.9	49.4
1,250	1.62	11.3	95.5	37.9	57.0
1,600	1.59	12.8	95.7	33.4	61.7
2,000	1.57	10.3	93.3	34.2	58.5
2,500	1.51	8.7	93.7	33.9	58.9
3,150	1.38	7.5	94.7	27.5	65.9
4,000	1.25	7.9	99.6	25.6	72.3
5,000	1.13	7.4	99.9	24.6	73.2

o Correction = 13 dB

Rating according to BS EN ISO 717-1:1997					
<b><i>D</i><sub>n,e,w</sub>(<i>C</i>; <i>C</i><sub>tr</sub>) = 45 (0;-3) dB</b>	<i>C</i> <sub>50-3150</sub> = -1 dB	<i>C</i> <sub>50-5000</sub> = 0 dB	<i>C</i> <sub>100-5000</sub> = 1 dB		
	<i>C</i> <sub>tr,50-3150</sub> = -	<i>C</i> <sub>tr,50-5000</sub> = -	<i>C</i> <sub>tr,100-5000</sub> = -3 dB		
Evaluation based on laboratory measurement results obtained by an engineering method					
Based on the data provided in BS EN 20140-2:1993 it is estimated that the measurement uncertainty should not exceed ±1 dB for the single quantity ( <i>D</i> <sub>n,e,w</sub> ) and should not exceed the values in Table A1 of BS EN 20140-2:1993 for the data in the individual third octaves ( <i>D</i> <sub>n,e</sub> )					

This page may only be distributed with the test report in its entirety and in accordance with the terms and conditions of the contract



**Laboratory measurement of airborne sound insulation of small building elements**  
**Element-normalized level difference according to BS EN 20140-10:1992**  
**BRE horizontal transmission suite (B9)**  
 Client: Rytons Building Products Ltd  
 Test date: 12/02/2013 Test number: L112-077 Test element: vent

0578

Filler wall area: 9.8 m<sup>2</sup>


Description:

AAC125LPCWL – Cowled Super Acoustic LookRyt® AirCore®

Source room volume: 130 m<sup>3</sup>  
 Receive room volume: 115 m<sup>3</sup>

Air temperature: 9 °C  
 Air relative humidity: 55 %

Frequency (Hz)	$D_{n,e}$ One-third octave (dB)
50	24.3
63	24.7
80	32.2
100	39.6
125	43.3
160	44.0
200	38.7
250	33.7
315	36.5
400	35.1
500	38.9
630	43.1
800	45.6
1,000	49.4
1,250	57.0
1,600	61.7
2,000	58.5
2,500	58.9
3,150	65.9
4,000	72.3
5,000	73.2

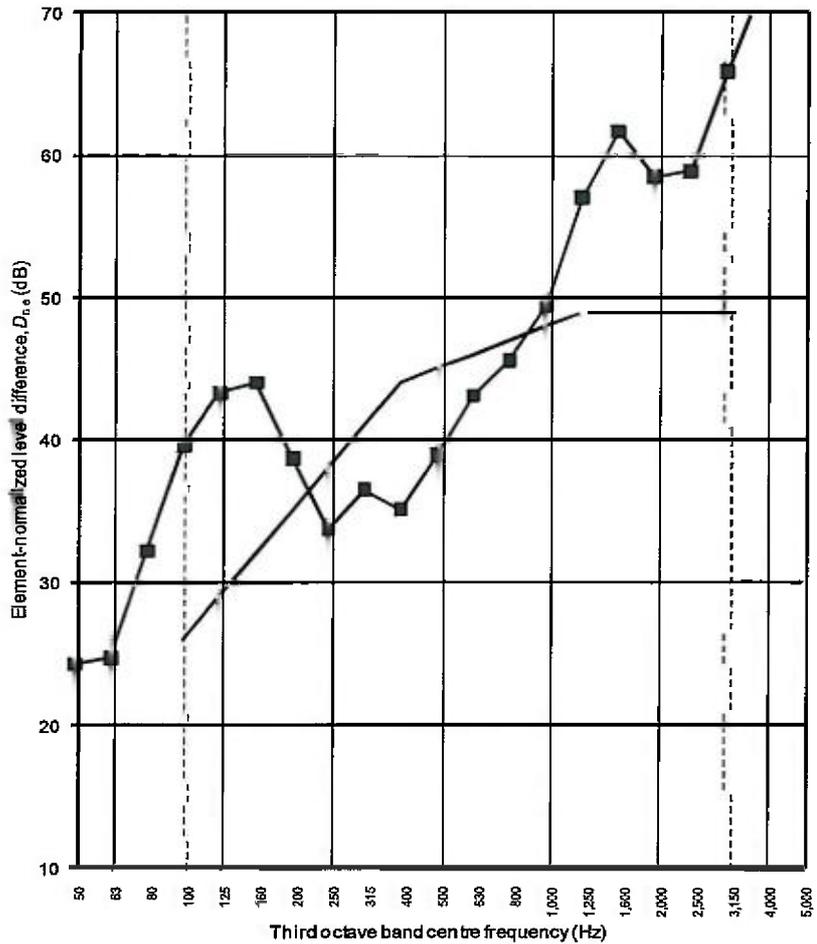

o Correction = 1.3 dB

Rating according to BS EN ISO 717-1:1997

$D_{n,e,w}(C;C_{tr}) = 45 (0;-3) \text{ dB}$      $C_{50-3150} = -1 \text{ dB}$      $C_{50-5000} = 0 \text{ dB}$      $C_{100-5000} = 1 \text{ dB}$   
 $C_{tr,50-3150} = -$      $C_{tr,50-5000} = -$      $C_{tr,100-5000} = -3 \text{ dB}$

Evaluation based on laboratory measurement results obtained by an engineering method

Based on the data provided in BS EN 20140-2:1993 it is estimated that the measurement uncertainty should not exceed  $\pm 1 \text{ dB}$  for the single quantity ( $D_{n,e,w}$ ) and should not exceed the values in Table A1 of BS EN 20140-2:1993 for the data in the individual third octaves ( $D_{n,e,w}$ )

This page may only be distributed with the test report in its entirety and in accordance with the terms and conditions of the contract



**Laboratory measurement of airborne sound insulation of small building elements**  
**Element-normalized level difference according to BS EN 20140-10:1992**  
**BRE horizontal transmission suite (B9)**  
 Client: Rytons Building Products Ltd  
 Test date: 12/02/2013      Test number: L112-078      Test element: vent

0578

Filler wall area: 9.8 m<sup>2</sup>

Description:

AAH125LP-High Rise Super Acoustic LookRyt® AirCore®

Source room volume: 130 m<sup>3</sup>  
 Receive room volume: 115 m<sup>3</sup>

Air temperature: 9 °C  
 Air relative humidity: 55 %

Frequency (Hz)	Reverberation time (s)	Background level (dB)	Source level (dB)	Receive level (dB)	$D_{n,e}$ (dB)
50	1.68	23.1	92.7	69.3	24.3
63	1.51	20.1	97.8	73.1	25.1
80	1.28	17.7	96.7	64.7	31.7
100	1.56	19.4	97.9	59.0	39.5
125	1.72	16.6	98.6	56.0	43.7
160	1.72	16.8	96.6	52.4	45.2
200	1.80	12.1	98.4	57.2	41.6
250	1.58	14.6	96.2	59.3	36.2
315	1.66	11.0	93.9	56.0	37.4
400	1.60	11.8	92.6	53.1	38.9
500	1.57	15.7	93.6	55.6	37.4
630	1.61	14.7	95.2	54.7	39.9
800	1.59	12.1	95.5	53.9	41.0
1,000	1.56	9.3	95.0	49.0	45.3
1,250	1.62	11.3	95.4	41.5	53.4
1,600	1.59	12.8	95.7	36.9	58.2
2,000	1.57	10.3	93.3	39.2	53.4
2,500	1.51	8.7	93.7	37.6	55.2
3,150	1.38	7.5	94.6	31.0	62.3
4,000	1.25	7.9	99.6	28.6	69.3
5,000	1.13	7.4	99.9	26.8	70.9

x Adjusted for flanking transmission

o Correction = 13 dB

Rating according to BS EN ISO 717-1:1997					
$D_{n,e,w}(C;C_{tr}) = 44 (0;-2) \text{ dB}$	$C_{50-3150} = 0 \text{ dB}$	$C_{50-5000} = 1 \text{ dB}$	$C_{100-5000} = 1 \text{ dB}$	$C_{tr,50-3150} = -$	$C_{tr,100-5000} = -2 \text{ dB}$
Evaluation based on laboratory measurement results obtained by an engineering method					
Based on the data provided in BS EN 20140-2:1993 it is estimated that the measurement uncertainty should not exceed $\pm 1 \text{ dB}$ for the single quantity ( $D_{n,e,w}$ ) and should not exceed the values in Table A1 of BS EN 20140-2:1993 for the data in the individual third octaves ( $D_{n,e,w}$ )					

This page may only be distributed with the test report in its entirety and in accordance with the terms and conditions of the contract



**Laboratory measurement of airborne sound insulation of small building elements**  
**Element-normalized level difference according to BS EN 20140-10:1992**  
**BRE horizontal transmission suite (B9)**  
 Client: Rytons Building Products Ltd  
 Test date: 12/02/2013      Test number: L112-078      Test element: vent

0578

Filler wall area: 9.8 m<sup>2</sup>


Description:

AAH125LP-High Rise Super Acoustic LookRyt® AirCore®

Source room volume: 130 m<sup>3</sup>  
 Receive room volume: 115 m<sup>3</sup>

Air temperature: 9 °C  
 Air relative humidity: 55 %

Frequency (Hz)	$D_{n,e}$ One-third octave (dB)
50	24.3
63	25.1
80	31.7
100	39.5
125	43.7
160	45.2
200	41.6
250	36.2
315	37.4
400	38.9
500	37.4
630	39.9
800	41.0
1,000	45.3
1,250	53.4
1,600	58.2
2,000	53.4
2,500	55.2
3,150	62.3
4,000	69.3
5,000	70.9

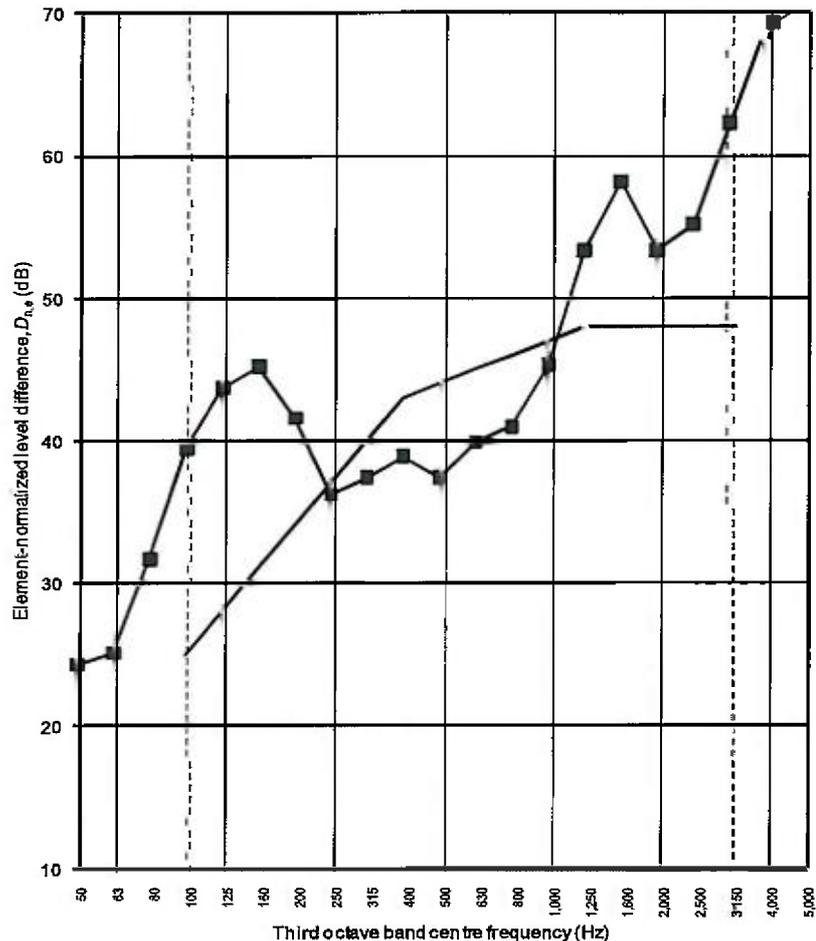

x Adjusted for flanking transmission

o Correction = 1.3 dB


Rating according to BS EN ISO 717-1:1997

$D_{n,e,w}(C;C_{tr}) = 44 (0;-2) \text{ dB}$        $C_{50-3150} = 0 \text{ dB}$        $C_{50-5000} = 1 \text{ dB}$        $C_{100-5000} = 1 \text{ dB}$   
 $C_{tr,50-3150} = -$        $C_{tr,50-5000} = -$        $C_{tr,100-5000} = -2 \text{ dB}$

Evaluation based on laboratory measurement results obtained by an engineering method

Based on the data provided in BS EN 20140-2:1993 it is estimated that the measurement uncertainty should not exceed  $\pm 1 \text{ dB}$  for the single quantity ( $D_{n,e,w}$ ) and should not exceed the values in Table A1 of BS EN 20140-2:1993 for the data in the individual third octaves ( $D_{n,e,w}$ )

This page may only be distributed with the test report in its entirety and in accordance with the terms and conditions of the contract

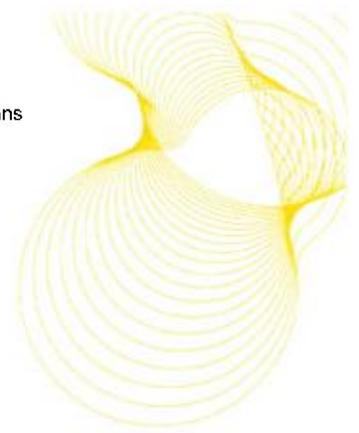

<i>f</i> / Hz	<i>R</i> / dB	<i>R<sub>occl</sub></i> / dB
50	25.0	
63	25.6	26.6
80	31.7	
100	39.9	
125	43.2	42.3
160	46.0	
200	43.0	
250	37.7	37.8
315	35.5	
400	37.3	
500	37.5	38.0
630	39.4	
800	40.6	
1000	44.5	43.6
1250	51.4	
1600	56.1	
2000	51.8	53.1
2500	52.6	
3150	56.5	
4000	59.2	58.1
5000	59.3	


AAC125TUBE- Rytons Super  
Acoustic AirCore® Tube

L112-072

<i>f</i> / Hz	<i>R</i> / dB	<i>R<sub>occl</sub></i> / dB
50	24.2	
63	25.5	26.1
80	31.8	
100	40.2	
125	43.0	42.4
160	45.4	
200	41.7	
250	35.9	37.5
315	36.9	
400	38.3	
500	37.1	38.1
630	39.1	
800	39.8	
1000	44.9	43.3
1250	53.9	
1600	56.3	
2000	53.5	55.4
2500	57.4	
3150	62.6	
4000	70.7	66.2
5000	71.0	

AAC125LP- Rytons Super Acoustic  
LookRyt® AirCore®

L112-076

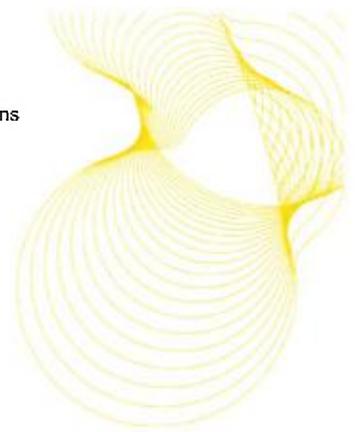

f/ Hz	R/ dB	R <sub>oct</sub> / dB
50	24.3	
63	24.7	25.9
80	32.2	
100	39.6	
125	43.3	41.8
160	44.0	
200	38.7	
250	33.7	35.8
315	36.5	
400	35.1	
500	38.9	37.9
630	43.1	
800	45.6	
1000	49.4	48.6
1250	57.0	
1600	61.7	
2000	58.5	59.5
2500	58.9	
3150	65.9	
4000	72.3	69.2
5000	73.2	

L112-077

AAC125LPCWL - Rytons Cowled  
Super Acoustic LookRyt® AirCore®

f/ Hz	R/ dB	R <sub>oct</sub> / dB
50	24.3	
63	25.1	26.0
80	31.7	
100	39.5	
125	43.7	42.1
160	45.2	
200	41.6	
250	36.2	37.9
315	37.4	
400	38.9	
500	37.4	38.6
630	39.9	
800	41.0	
1000	45.3	44.2
1250	53.4	
1600	58.2	
2000	53.4	55.2
2500	55.2	
3150	62.3	
4000	69.3	65.8
5000	70.9	

L112-078

AAH125LP - Rytons High Rise  
Super Acoustic LookRyt® AirCore®