


Technical Data Sheet

Rytons Cowled 150mm Acoustic AirCore® (38 dB) (Sound and Draught Reducing)


www.vents.co.uk (search code: AAC625CW)

May 2010


Dimensional Drawing

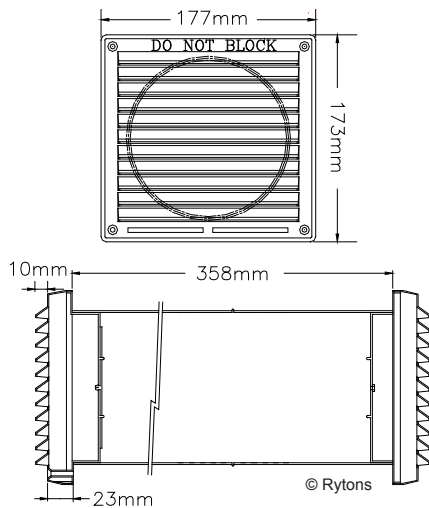

In-Situ Line Drawing

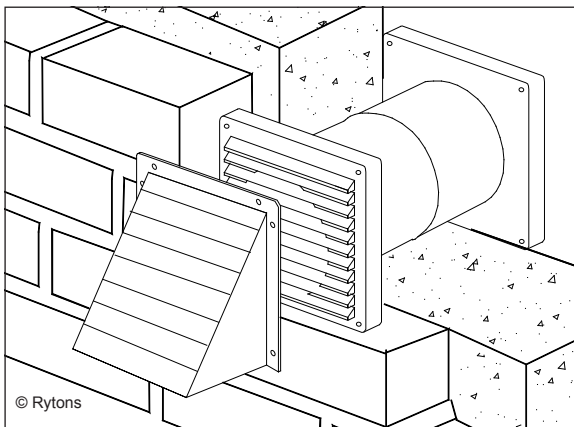

In-Situ Drawing



Approvals and Testing



Main Uses, Features and Benefits

- Combustion air vent for heat producing appliances.
- Room or compartment ventilator.
- Acoustic lining reduces sound to 38 dB $D_{n,e,w}$
- $D_{n,e,w}$ figure calculated by the BRE in accordance with BS EN ISO 717-1:1997.
- HETAS approved for use with solid fuel appliances.
- Equivalent area calculated by the BRE at 15 Pa to BS 5440-2:2000.
- Cowl reduces light and draughts.
- Fits into core drilled hole - suitable for retrofit installations.
- Grilles and cowl U.V. stabilised to protect against deterioration by sunlight.



F30 Accessories/Sundry Items for Brick/Block/Stone Walling

Specification clauses 17, 171

U90 General Ventilation - Domestic

Specification clauses 30, 34, 310, 340

Product Specification Code	$D_{n,e,w}$	Equivalent Area
Rytons AAC625CW	38 dB	7511mm ² (75.11cm ²) (11½"²)

Size

Cowl: 217mm (L) x 210mm (H) x 93mm (D).

Louvre Ventilators: 177mm (L) x 173mm (H).

Tube: 151mm (6") (Dia.) x 358mm (L).

AutoCAD drawings available by email.

Gas Appliances

Suitable for an open-flued gas appliance installed in a room or internal space with a gross rated input up to 22kW.

Solid Fuel Appliances

(e.g. Stoves, Range Cookers or Independent Boilers)

Closed appliance without a draught stabiliser fitted - suitable up to 18kW.

Closed appliance with a draught stabiliser fitted - suitable up to 12kW.

Composition

Cowl: U.V. stabilised high impact polystyrene.

External Louvre: U.V. stabilised high impact polystyrene.

Tube: High impact polystyrene containing sound absorbent foam lining.

Tube contains recycled plastic.

Internal Louvre: U.V. stabilised high impact polystyrene.

Softening/Melting Points

Tube (unlined): Softening point 70°C. Melting point 120°C.



Technical Data Sheet

www.vents.co.uk (search code: AAC625CW)



Rytons Cowled 150mm Acoustic AirCore® (38 dB) (Sound and Draught Reducing)

May 2010

Colour Key



Photo Library

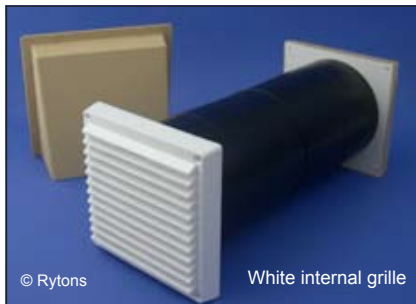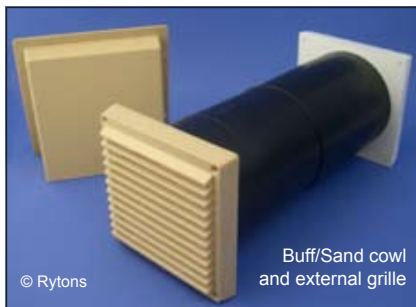

Colours

Cowl: White, buff/sand, terracotta.
External Louvre: White, buff/sand, terracotta.
Tube: Black.
Internal Louvre: White.

Specification Paragraph

Manufacturer: Rytons Building Products Ltd
T: 01536 511874, F: 01536 310455, E: admin@rytons.com
Visit our website at www.vents.co.uk

- Product ref:
- Rytons Cowled 150mm Acoustic AirCore® (38 dB) White (ref AAC625WCW)
 - Rytons Cowled 150mm Acoustic AirCore® (38 dB) Buff/Sand (ref AAC625BCW)
 - Rytons Cowled 150mm Acoustic AirCore® (38 dB) Terracotta (ref AAC625TCW)

Type: Acoustic Core Ventilator with Internal and External Grilles
Equivalent Area: 7511mm² (BRE tested)

Installation

Drill a hole using a 151mm core drill. Cut tube to length if necessary. Insert tube into hole. Push fit internal and external louvres (screw to the brickwork for extra security). Fasten cowl to the brickwork through the pre-formed holes in the flange around the cowl.

Extra Features and Benefits

Individually boxed sets for easy identification, handling and efficient installation.

Interlocking components aid correct positioning, alignment and easy installation.

Injection moulded one piece tube makes handling easier and installation quicker.

External water baffle prevents transfer of water across the cavity.

Internal and external louvre grilles embossed with DO NOT BLOCK.

UK Regulations, Standards and Guidelines

Measurement of airborne sound insulation made by the BRE in accordance with BS EN 20140-10:1992 and BS EN ISO 140-3:1995. Single number quantities were calculated in accordance with BS EN ISO 717-1:1997 'Rating of sound insulation in buildings and of building elements'.

For heat producing appliances (including solid fuel) refer to:

- The Building Regulations 2000, Approved Document J.
- The Building (Scotland) Regulations 2005, Mandatory Standard 3.21.
- The Building Regulations (Northern Ireland) 2000, Technical Booklet L.
- British Standard BS 5440-2:2009.

For decorative fuel effect gas fires refer to:

- British Standard BS 5871-3:2005.

The Building Regulations 2000, Approved Document J

1.16 In noisy areas, it may be necessary to install proprietary noise attenuated ventilators to limit the entry of noise into the building.

Technical Data Sheet

www.vents.co.uk (search code: AAC625CW)

Rytons Cowled 150mm Acoustic AirCore® (38 dB) (Sound and Draught Reducing)

May 2010

Rytons AAC625CW Converted Octave Band Values	
63 Hz	33.6 dB
125 Hz	40.3 dB
250 Hz	29.9 dB
500 Hz	32 dB
1000 Hz	52.6 dB
2000 Hz	57.8 dB
4000 Hz	61.9 dB

All figures are reproduced in good faith and to the best of our knowledge are true and accurate. Customers should satisfy themselves that the product is suitable for the intended purpose by using this information in conjunction with the BRE acoustic test report available online at www.vents.co.uk and from Rytons sales office.

A bit about the BRE

The Building Research Establishment Ltd is a respected independent testing authority. BRE Acoustics holds UKAS accreditation for the measurement of sound insulation in the field and the laboratory. The measurements were conducted using the procedures accredited by UKAS. Since 2006 Rytons has commissioned the BRE to calculate the equivalent free area of their heat producing appliance and background ventilators giving installers, suppliers and homeowners the confidence that the air space is **accurate** and **verifiable**.

Handling Information

Box quantity: 1 set.
Box size: 44cm (W) x 19cm (H) x 22.5cm (D).
Box weight: 0.99kg.

Questions

Is a copy of the BRE test report available?

Yes, online at www.vents.co.uk or from Rytons sales office.

Will installing more than one vent to achieve a greater free area have an effect on the acoustic performance?

Yes, by installing two vents anywhere in a room the combined performance of both vents would be reduced by 3dB. Installing four vents would give a reduction of 6dB.

Will the vent reduce sound from inside to outside as well as from outside to inside?

The BRE has advised us that it's reasonable to assume that 'reciprocity' applies to the vents. That is, the third octave values for sound reduction index are the same in both directions (out to in and in to out).



Please recycle printouts where facilities exist.

