



Technical Data Sheet

Rytons '9x9' Cowled Acoustic AirLiner® Set with Hit & Miss Ventilator (40 dB) (Sound, Light and Draught Reducing)

www.vents.co.uk (search code: TAL9HMCWL)

April 2010

Dimensional Drawing (Rytons TAL9900)

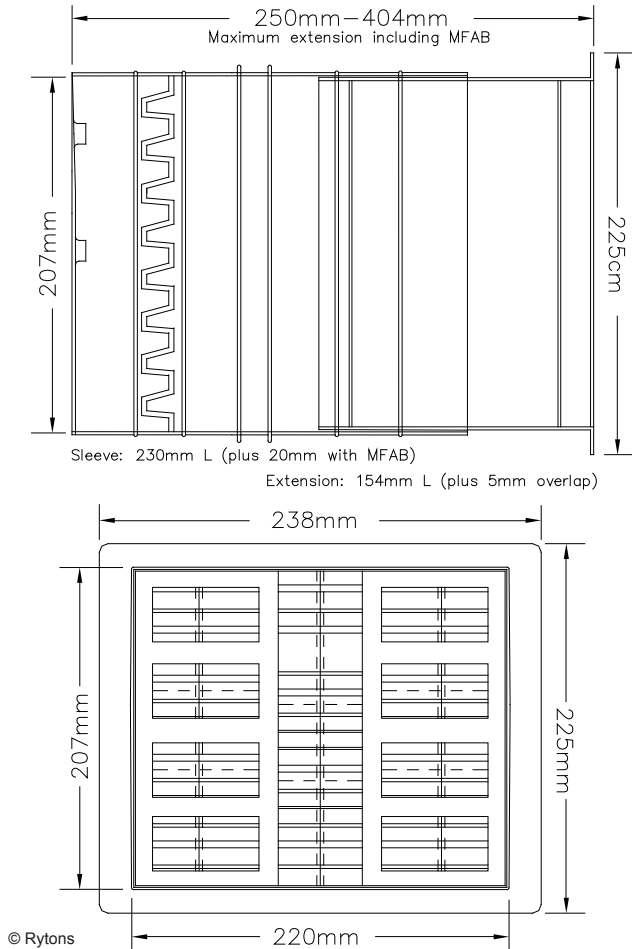

Approvals and Testing



Main Uses, Features and Benefits

- Acoustic background ventilator for a habitable room.
- Acoustic lining reduces sound to 40 dB $D_{n,e,w}$
- $D_{n,e,w}$ figure calculated by the BRE in accordance with BS EN ISO 717-1:1997.
- Equivalent area calculated by the BRE at 1 Pa to BS EN 13141-1:2004.
- Cowl and internal baffles reduce light and draughts.
- Manually controlled internal hit & miss ventilator with flyscreen.
- Set contains Rytons Cowl '9x9' (ABC9), Rytons Multifix® Air Bricks (MFAB) x3, Rytons '9x9' Acoustic AirLiner® (TAL9900) and Rytons Hit & Miss Ventilator '9x9' (HM123F).
- U.V. stabilised cowl, air brick and hit & miss ventilator to protect against deterioration by sunlight.



F30 Accessories/Sundry Items for Brick/Block/Stone Walling

Specification clauses 17, 171

U90 General Ventilation - Domestic

Specification clauses 34, 340

Product Specification Code	Equivalent Area	$D_{n,e,w}$
Rytons TAL9HMCWL	5000mm ² (50cm ²)	40 dB (open) 41 dB (closed)

Size

ABC9: 274mm (L) x 235mm (H) x 103mm (D).

MFAB & TAL9900: 220mm (W) x 207mm (H).

Extends from 250mm to 404mm (L) with Rytons Multifix® Air Bricks fitted.

HM123F: 271mm (L) x 247mm (H).

Composition

ABC9: U.V. stabilised high impact polystyrene.

MFAB: U.V. stabilised polypropylene.

TAL9900: Rigid Liner - Polypropylene. **Contains recycled plastic.**

TAL9900: Insert Sleeve - Polypropylene containing sound absorbent foam panels.

HM123F: U.V. stabilised high impact polystyrene.



Technical Data Sheet

www.vents.co.uk (search code: TAL9HMCWL)



April 2010

Rytons '9x9' Cowled Acoustic AirLiner® Set with Hit & Miss Ventilator (40 dB) (Sound, Light and Draught Reducing)

Colour Key



Photo Library

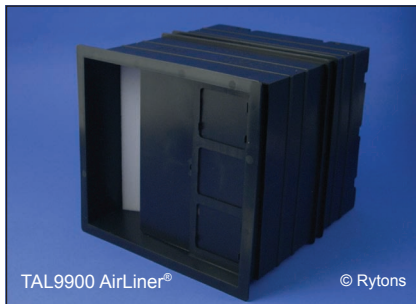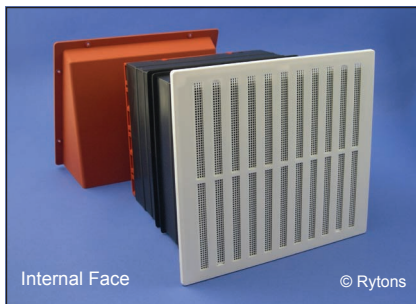

Colours

ABC9: Buff/sand, terracotta, white.
MFAB: Buff/sand, terracotta, white.
TAL9900: Black.
HM123F: White.

Specification Paragraph

Manufacturer: Rytons Building Products Ltd
T: 01536 511874, F: 01536 310455, E: admin@rytons.com
Visit our website at www.vents.co.uk
Product ref:

- Rytons '9x9' Cowled Acoustic AirLiner® Set with Hit & Miss Ventilator (40 dB) Buff/Sand (ref TAL9HMBCWL)
- Rytons '9x9' Cowled Acoustic AirLiner® Set with Hit & Miss Ventilator (40 dB) Terracotta (ref TAL9HMTWCWL)
- Rytons '9x9' Cowled Acoustic AirLiner® Set with Hit & Miss Ventilator (40 dB) White (ref TAL9HMWCWL)

Type: Acoustic Telescopic Liner with Cowl, Multifix® Air Brick and Hit & Miss
Equivalent Area: 5000mm² (BRE tested)

Installation

No special fixing required. Build in cavity liner with fitted air bricks as work proceeds. Extend telescopic sleeve as necessary. Fasten cowl to the brickwork through the pre-formed holes in the flange around the cowl. Fasten hit & miss ventilator internally covering the flange of the AirLiner®. To avoid discomfort from cold draughts the ventilator should be sited not less than 1.7m above floor level.

Extra Features and Benefits

Individually boxed sets for easy identification, handling and efficient installation.

Cowl prevents infiltration of wind driven rain and snow and alleviates air blasts through the cavity which may cause discomfort in a room.

Air brick louvres promote unrestricted air flow and reduce the risk of blockage as well as keeping large insects out. Also features built-in water baffles to prevent water penetration.

External AirLiner® baffles prevent water transfer across the cavity.

Flush face and slim design of the hit & miss gives a neat internal appearance.

Hit & miss quickly and easily installed and removed for cleaning.

Technical Data Sheet

www.vents.co.uk (search code: TAL9HMCWL)

April 2010

Rytons '9x9' Cowled Acoustic AirLiner® Set with Hit & Miss Ventilator (40 dB) (Sound, Light and Draught Reducing)

Rytons TAL9HMCWL Converted Octave Band Values	
63 Hz	34.5 dB
125 Hz	37.8 dB
250 Hz	31.8 dB
500 Hz	33.8 dB
1000 Hz	43.4 dB
2000 Hz	52 dB
4000 Hz	56.8 dB

All figures are reproduced in good faith and to the best of our knowledge are true and accurate. Customers should satisfy themselves that the product is suitable for the intended purpose by using this information in conjunction with the BRE acoustic test report available online at www.vents.co.uk and from Rytons sales office.

A bit about the BRE

The Building Research Establishment Ltd is a respected independent testing authority. BRE Acoustics holds UKAS accreditation for the measurement of sound insulation in the field and the laboratory. The measurements were conducted using the procedures accredited by UKAS. Since 2006 Rytons has commissioned the BRE to calculate the equivalent free area of their heat producing appliance and background ventilators giving installers, suppliers and homeowners the confidence that the air space is **accurate** and **verifiable**.

UK Regulations, Standards and Guidelines

Measurement of sound insulation made by BRE in accordance with BS EN 20140-10:1992 'Laboratory measurement of airborne sound insulation of small building elements'. Single number quantities were calculated in accordance with BS EN ISO 717-1:1997 'Rating of sound insulation in buildings and of building elements'.

The Building Regulations 2000, Approved Document F 2006 edition.

The Building (Scotland) Regulations 2007, Mandatory Standard 3.14.

The Building Regulations (Northern Ireland) 2000, Technical Booklet K.

British Standard BS 5250:2002.

The Building Regulations 2000, Approved Document F

Noisy locations 0.31 In noisy areas it may be appropriate to use sound-attenuating background ventilators, depending on the noise level and any planning conditions.

Handling Information

Box quantity: 1 set.

Box size: 27.5cm (W) x 28.5cm (H) x 27cm (D).

Box weight: 1.79kg.

Questions

Is a copy of the BRE test report available?

Yes, online at www.vents.co.uk or from Rytons sales office.

Will installing more than one vent to achieve a greater free area have an effect on the acoustic performance?

Yes, by installing two vents anywhere in a room the combined performance of both vents would be reduced by 3dB. Installing four vents would give a reduction of 6dB.

Will the vent reduce sound from inside to outside as well as from outside to inside?

The BRE has advised us that it's reasonable to assume that 'reciprocity' applies to the vents. That is, the third octave values for sound reduction index are the same in both directions (out to in and in to out).



Please recycle printouts where facilities exist.

